
CL-617+plexiglass

Type: Exit sign luminaire Mounting: Ceiling Light source: 50.000h operational time, 6000K color temperature Warranty: 2 years Housing color and material: White plastic Dimensions: 315mm x 102mm x 228mm Cable connection: Max. 2.5mm2 cross section or sleeved twisted wire Operating mode: Non-maintained / maintained


Constant nominal ambient temperature range: $0^\circ\text{C}{<}\text{Ta}{<}45^\circ\text{C}$



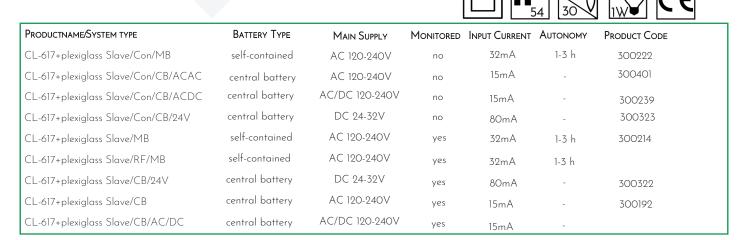

System Type Legend

Slave/Con/MB - self-contained, conventional, unmonitored Slave/Con/CB ACAC - central battery, conventional, unmonitored Slave/Con/CB ACDC - central battery, conventional, unmonitored Slave/Con/CB/24V - central battery, 24V, conventional, unmonitored Slave/MB - self-contained, central monitoring Slave/RF/MB - self-contained, wireless central monitoring Slave/CB/24V - central battery, 24V, central monitoring Slave/CB/24V - central battery, 24V, central monitoring Slave/CB - central battery, 230V, central monitoring Slave/CB AC/DC - central battery, AC 230V/DC 216V, central monitoring

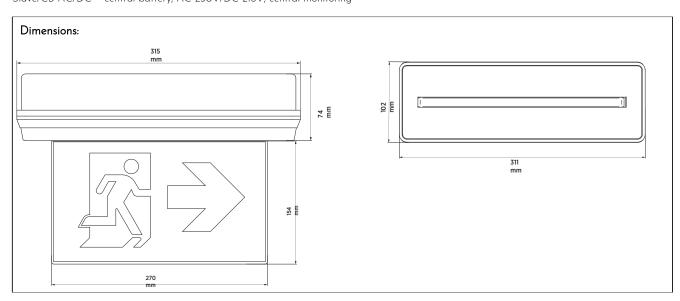

Unique identifier* - SLxxxx0020 copy this ID into commissioning book next to light's locatation and drawing text

Cable wiring - Connect the mains wire, the LED module to the luminaire on basis of the image. The proper phasing is important

because of the communication line. In case of reverse connection cannot occurs fault, but an incorrectly connected device influences the other luminaires' function on the line as well.

Changing the LED - Because of the LED's unique design, it can be changed by the manufacturer only.

Changing the battery** - An authorized person must replace the battery

*addressable devices only **self-contained devices only

CAUTION!

The device works from mains supply. The mounting should be happened only with the supplied retainers.

Important!

In case of maintenance ensure that the device is disconnected from the power.

The producer will not take the responsibility for the damages caused by improper usage.

All servicing should be performed by qualified service personnel.

The installation of this Emergency system shall be performed by an authorized personnel who is qualified to perform the installation in accordance with ANSI/NFPA 101, "Life Safety Code," Article 700 of ANSI/NFPA 70, the NEC "National Electrical Code," the Federal, State & local municipal requirements and or any other requirements as applicable and as warranted.

the product's system-specific data sheet is available by scanning the QR code on the product